


**SUPPLY AIR FILTER AND RETURN AIR DUCT
SMOKE DETECTION SYSTEM**

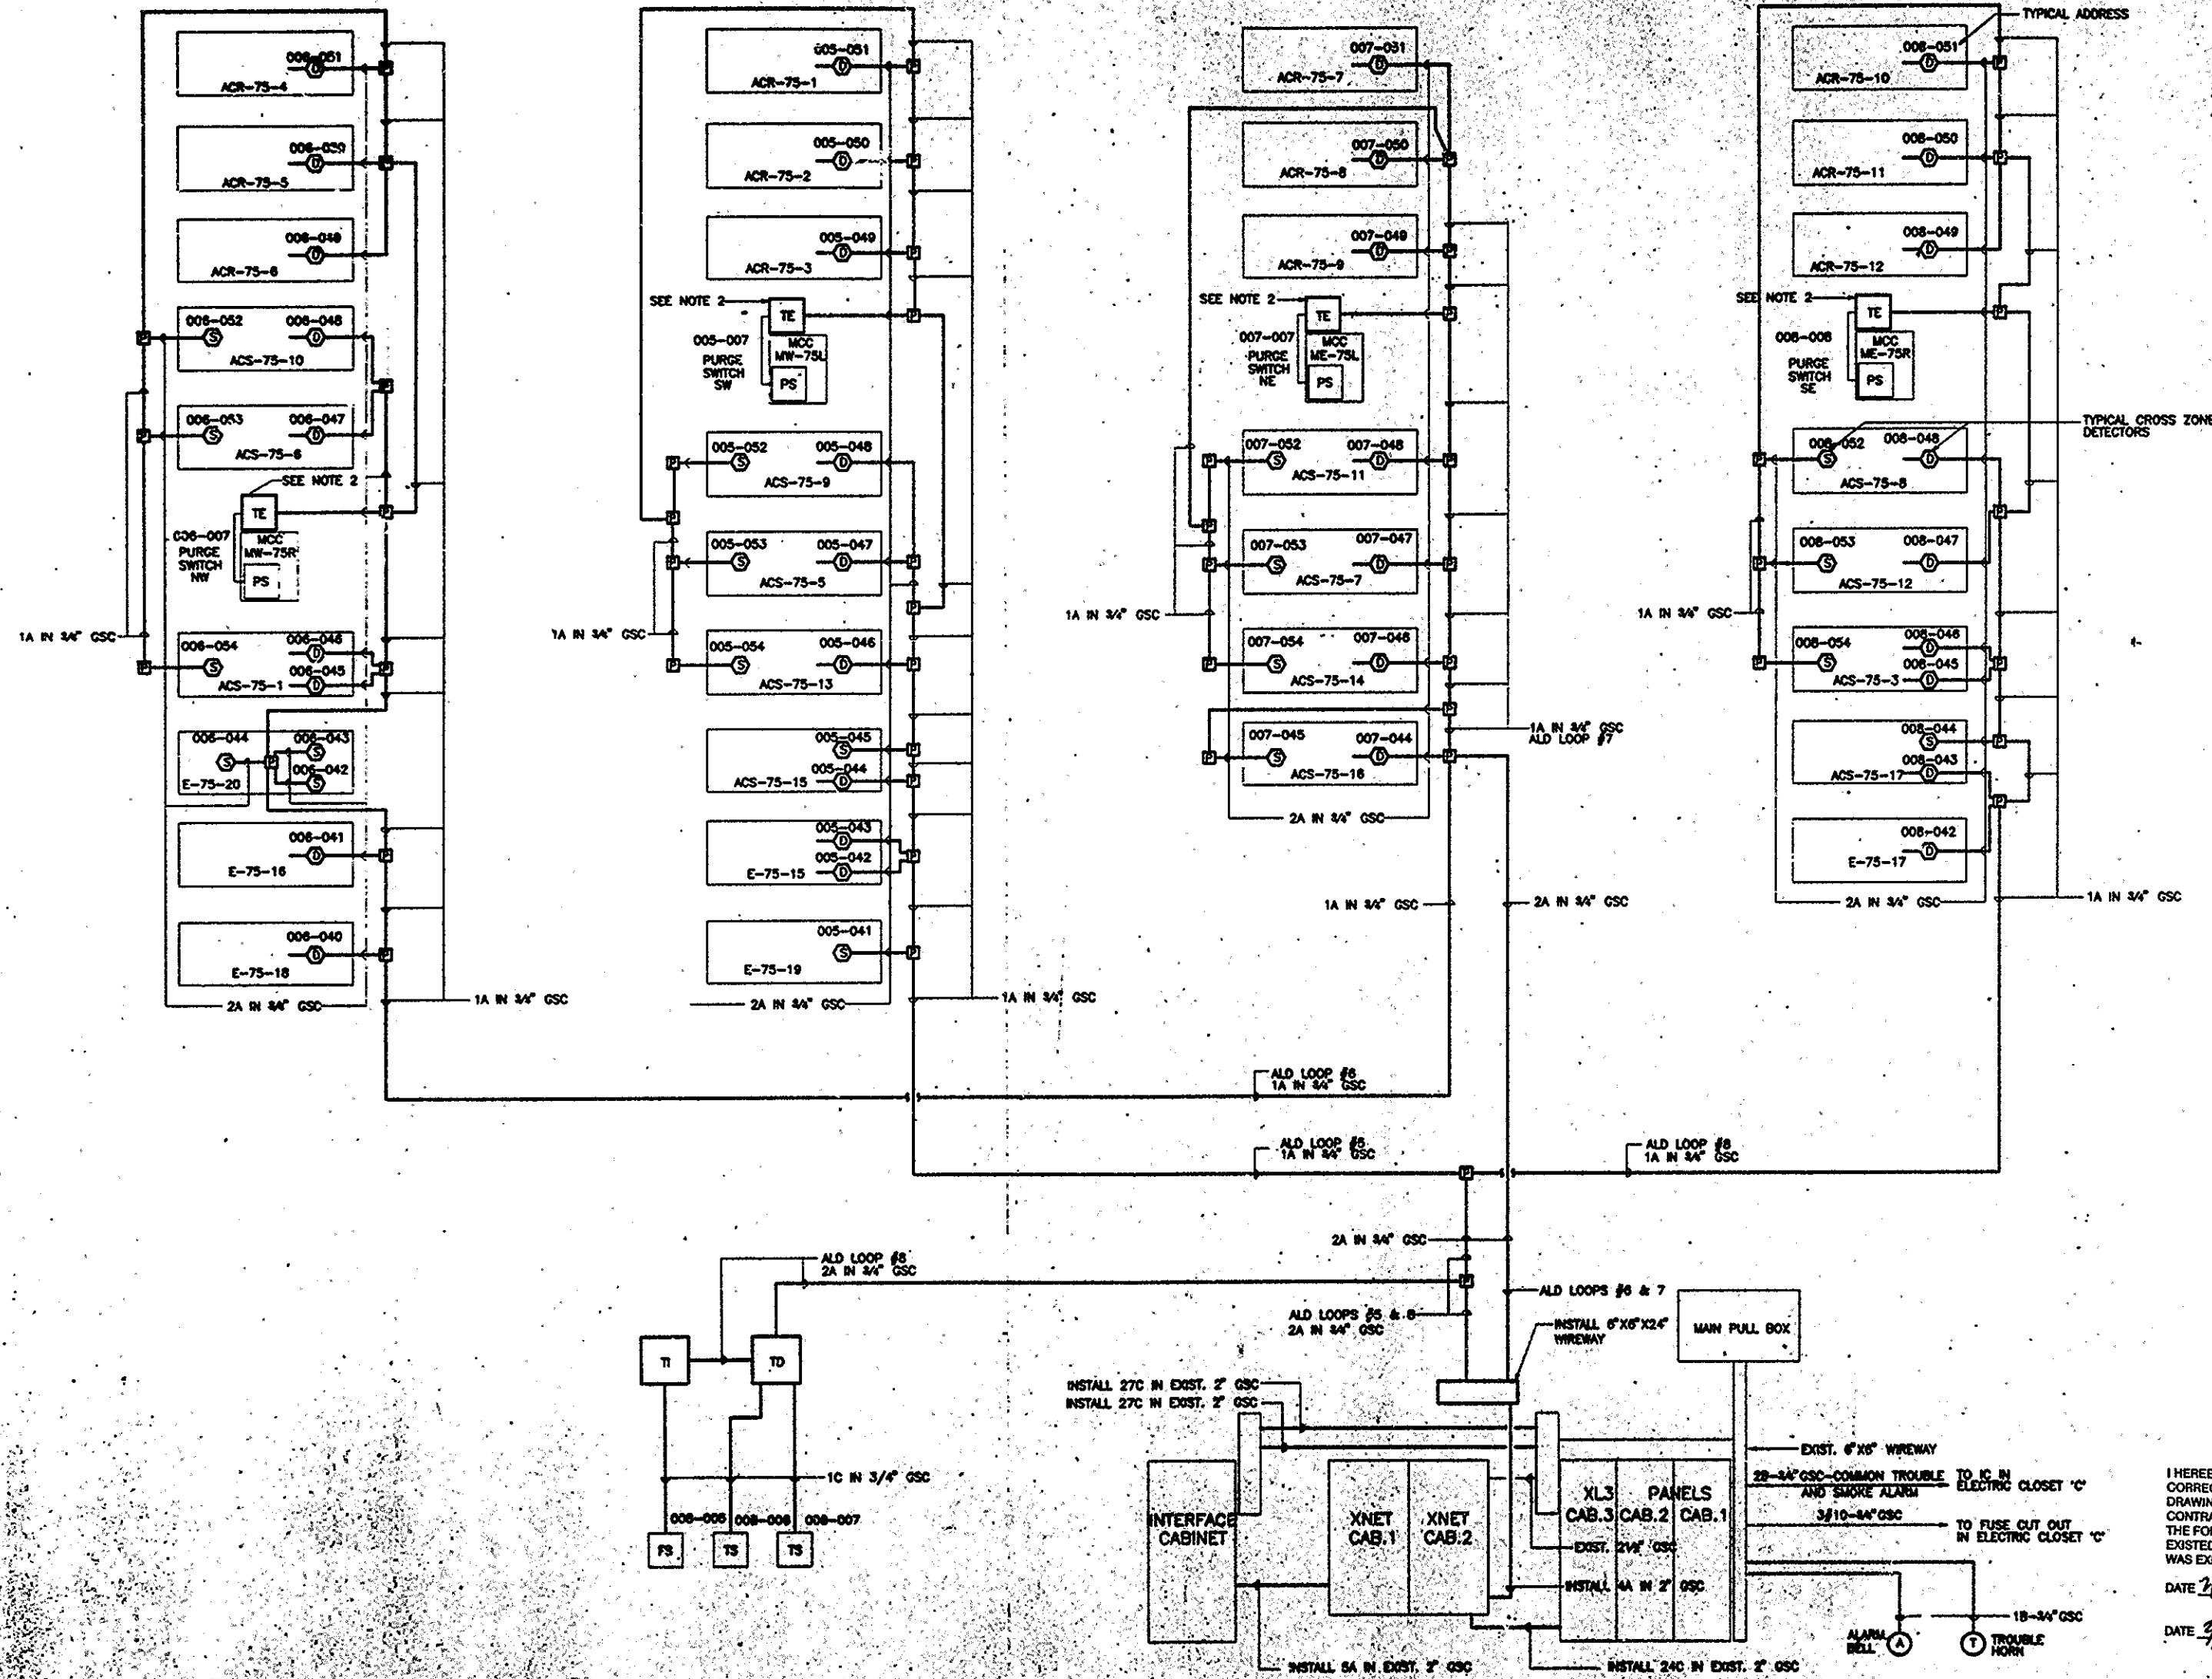

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE MCC AND INSTALL TRX-B6 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 75th FLOOR MER PLAN, SEE DWG E-35.
4. FOR 75th FLOOR MER REMOVAL PLAN, SEE DWG E-36.

Sheet 36 of 50

THE WORLD TRADE CENTER

ENGINEERING PROGRAM MANAGER
WORLD TRADE
[Signature]
CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approval

Engineering Department
Design Division

The World Trade Center

**FIRE ALARM SYSTEM
PHASE II
XL3 CONVERSION
ELECTRICAL
2 WTC
75th FLOOR MER
FIRE ALARM SYSTEM
RISER DIAGRAM**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

ROYZMAN
FELDSTEIN
Designed by: *[Signature]* Drawn by: *[Signature]* Checked by: *[Signature]*

Date 5-20-89 Scale NONE

Contract Number Drawing Number

WTC-861082 E-34

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861082-1-1 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/90 *[Signature]*

DATE 2/1/90 *[Signature]*

CONTRACT ENFORCEMENT
ENGINEERING PROGRAM MGR.